

Test Report

Distance tube made of fibre concrete

PB 1.1/ 12-148-4 Ä | 06.06.2012 | english

Testing the water penetration depth on concrete test pieces supplied with built-in distance tubes, sealed on both sides with one 5 cm fibre-reinforced concrete sealing cone in accordance with DIN EN 12390-8

Tested by: MFPA Leipzig GmbH, Leipzig



VMPA-accredited concrete test authority
VMPA-B-2003

Mfpa Leipzig GmbH

Test, Inspection and Certification Authority for
Building Materials, Products and Systems

Division I - Materials in Civil Engineering
Dipl.-Ing. Marko Orgass

Team 1.1 - Mineral Building Materials

Dipl.-Ing. M. Becker
Phone +49 (0) 341 - 6582-148
becker@mfpa-leipzig.de

Test report no. PB 1.1/12-148-4 Ä

Replaces PB 1.1/12-148-4 from 05.06.2012
from 06 June 2012
1. copy

Subject matter: Testing the water penetration depth on concrete test pieces supplied with built-in 'FRANK fibre-reinforced concrete distance tubes – MR 22', sealed on both sides with one 5 cm fibre-reinforced concrete sealing cone FBVK22T50 in accordance with DIN EN 12390-8

Client: Max Frank GmbH & Co. KG
Mitterweg 1
94339 Leiblfing

Date of order: 10.05.2012

Client's reference: J. Schmidbauer

Samples received on: 15.05.2012

Sampling: Client

Identification: D 1 to D 3

Date of testing: 29.05. to 01.06.2012

Person in charge: Dipl.-Ing. M. Becker

This document consists of 3 pages and 2 appendices.

This report may only be copied in an unabridged form. Any publication – including extracts – requires the prior written consent of Mfpa Leipzig GmbH. The German written form with original signatures and original stamp of the authorised signatory applies as the legally binding form.

The General Terms and Conditions of Business (GTC) of Mfpa Leipzig GmbH apply.



Testing laboratory accredited by DAKKS GmbH in accordance with DIN EN ISO/IEC 17025. The accreditation only applies for the testing methods listed in the certificate (marked with * in this document). The certificate can be seen at www.mfpa-leipzig.de.

Gesellschaft für Materialforschung und Prüfungsanstalt für das Bauwesen Leipzig mbH (Mfpa Leipzig GmbH)

Registered offices: Hans-Weigel-Str. 2b – 04319 Leipzig/Germany
Managing Director: Prof. Dr.-Ing. Frank Dehn
Companies' District Court Leipzig
Register: HRB 17719
VAT ID No.: DE 813200649
Tel.: +49 (0) 341 - 6582-0
Fax: +49 (0) 341 - 6582-135

1 Preliminary remarks

MFPA Leipzig GmbH was commissioned to test the water penetration depth in accordance with DIN EN 12390-8 [1] of concrete-cast 'FRANK fibre-reinforced concrete distance tubes – MR 22' with glued-in fibre-reinforced concrete sealing plugs/cones (edge length 15 cm). Unlike in the test specification, the test was performed on composite test pieces. The samples were stored at 20 °C under water until tested.

2 Test results

2.1 Sample identification

Series D: D 1 to D 3 sealed on both sides with one 5 cm sealing cone FBVK22T50, glued in with 'Repoxal two-pot adhesive'

Strength class: C 20/25

Date of manufacture: 10.04.2012

Date of testing: 29.05.2012

Age of sample: 49 days

2.2 Water penetration depth

At the end of the test the samples were split along the concrete-cast 'FRANK fibre-reinforced concrete distance tubes – MR22'. The test results are summarised in Table 1. Appendix 1 shows the water distribution after the test pieces were split. Appendix 2 contains a documentation of the test pieces after testing.

Table 1: Series D


Test piece	Water penetration depth [mm]
1	20
2	16
3	17


3 List of references

- [1] DIN EN 12390-3 'Testing hardened concrete – water penetration depth under pressure';
Edition 07/2009

The results of the tests refer exclusively to the test items described herein and not to the population. This document does not replace any certificate of conformity or usability as defined by the building regulations (national/European).

Leipzig, 06 June 2012


Dipl.-Ing. M. Orgass
Head of Division



Dipl.-Ing. M. Becker
Team Leader

The stamp contains the text: MFA Leipzig GmbH, SAC 02, NB 0800.

Appendices: Appendix 1 Test records of water penetration depth
Appendix 2 Documentation of the test pieces






Test record of the water penetration depth

MFPA LEIPZIG GmbH Hans-Weigel-Str. 2b 04139 Leipzig Tel. 0341 / 6582145	PRÜFUNG DER WASSERUNDURCHLÄSSIGKEIT VON BETON NACH DIN EN 12390-8	
---	---	---

Angaben des Auftraggebers			
[.....] Eignungsprüfung	[.....] Güteprüfung	SollprüfalterTage	
Baustelle / Bauwerk			
Bauteil / Entnahmestelle			
Transportbetonwerk			
Betonarten-Nr.:	Semi D		
Festigkeitsklasse	C 20/25		
TB Lieferschein-Nr.:			
Probekörper - Herstellungsdatum	03.04.2012		
Zul. Wassereindringtiefe (mm)			
Lagerung bis Einlieferung :	Tage in der Form bei °C und	Tage im Wasser bei °C	

Feststellungen der Prüfstelle

Tag der Einlieferung	15.05.2012	angenommen von : Becker	
äußere Beschaffenheit	i.O.		
nachträgliches Aufrauen	nein		
Lagerung bis zur Prüfung	14 Resttage in Wasser bei 20 °C		
Probekörper-Kennzeichen	D1	D2	D3
Beginn der Prüfung Datum	29.05.2012	29.05.2012	29.05.2012
Prüfalter bei Prüfbeginn Tage			
Abmessungen mm	150 x 150 x 150	150 x 150 x 150	150 x 150 x 150
Darstellung der Wasserverteilung nach dem Aufspalten der Prüfkörper			
größte Eindringtiefe e _w mm	20	16	17
größter Wert e _w mm	20		

Bemerkungen :

Leipzig
Ort

01.06.2012
Datum



SAC 02
NB 0800

Becker
Stempel / Unterschrift

Documentation of the test pieces

(Photos 1 to 3)



Photo 1: Series D 'FRANK fibre-reinforced concrete distance tubes – MR 22 each sealed with one 5 cm sealing cone FBVK22T50, sample 1

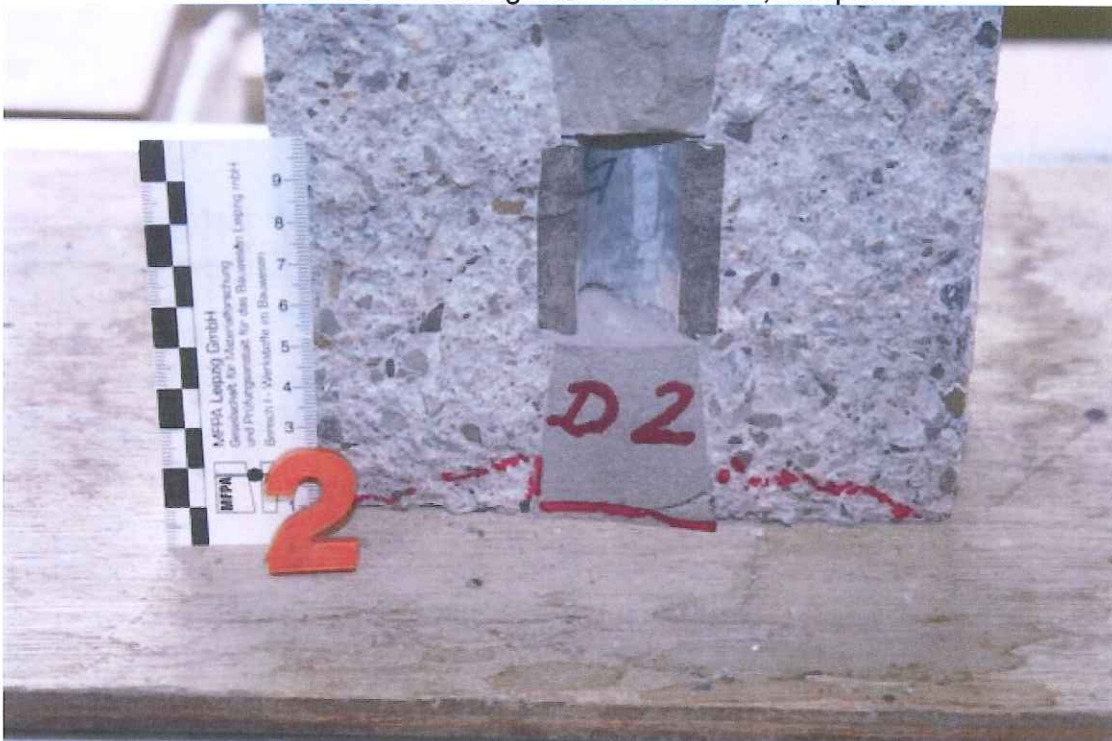


Photo 2: Series D 'FRANK fibre-reinforced concrete distance tubes – MR 22 each sealed with one 5 cm sealing cone FBVK22T50, sample 2

Documentation of the test pieces

(Photos 1 to 3)

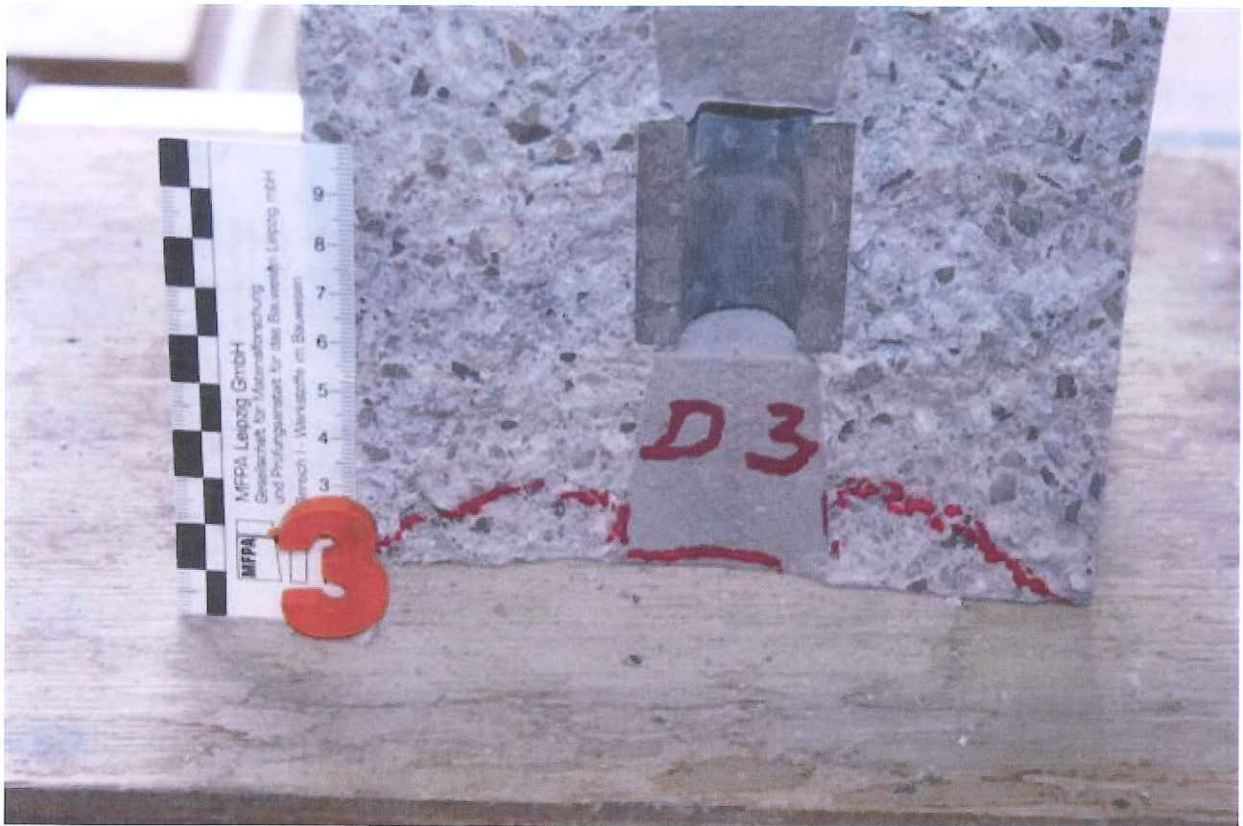


Photo 3: Series D 'FRANK' fibre-reinforced concrete distance tubes – MR 22 each sealed with one 5 cm sealing cone FBVK22T50, sample 3